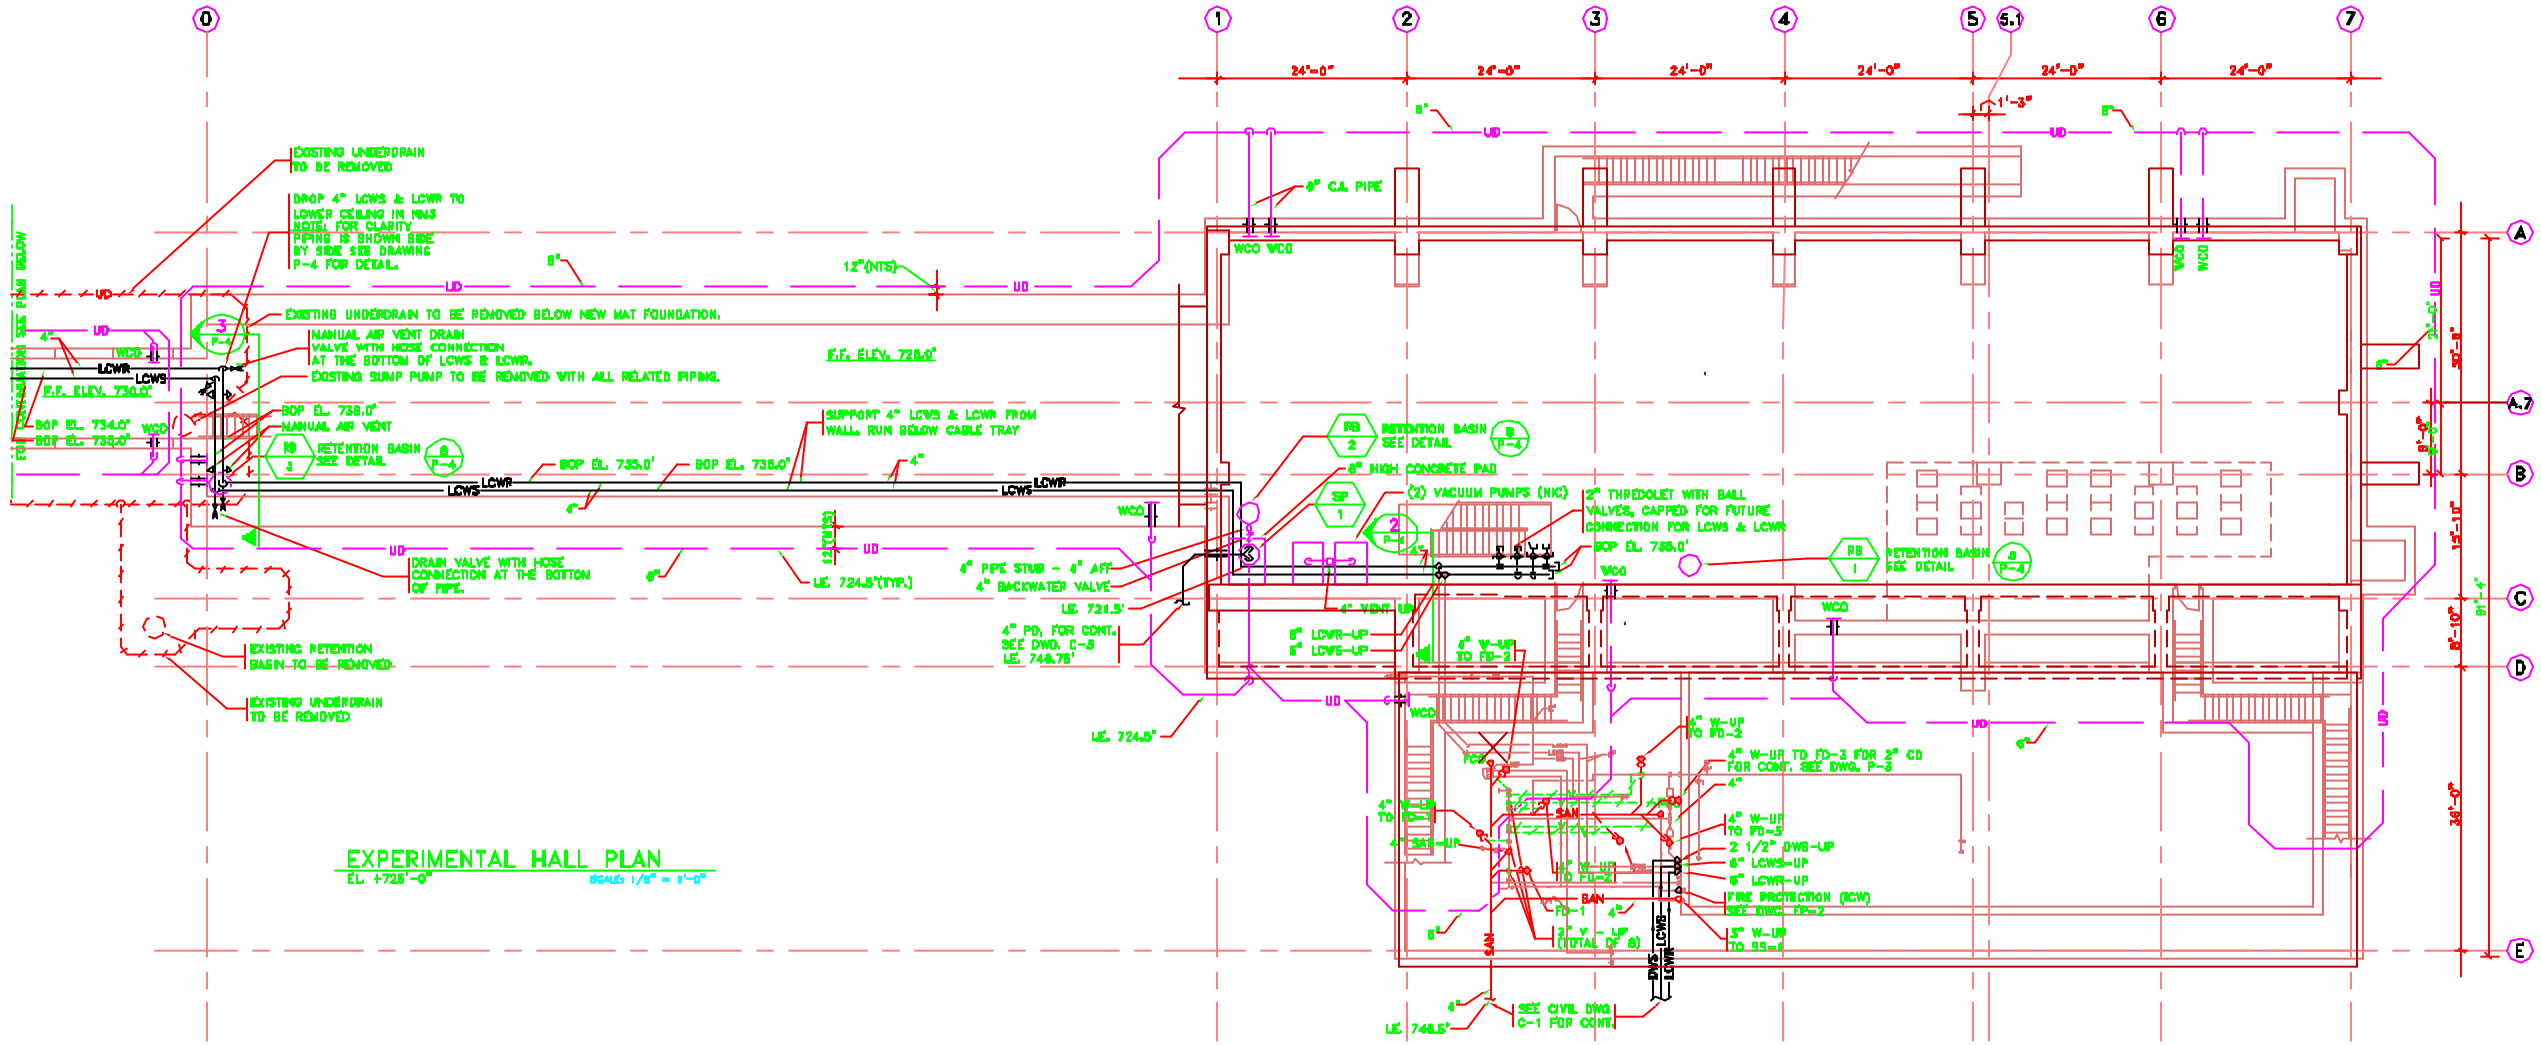

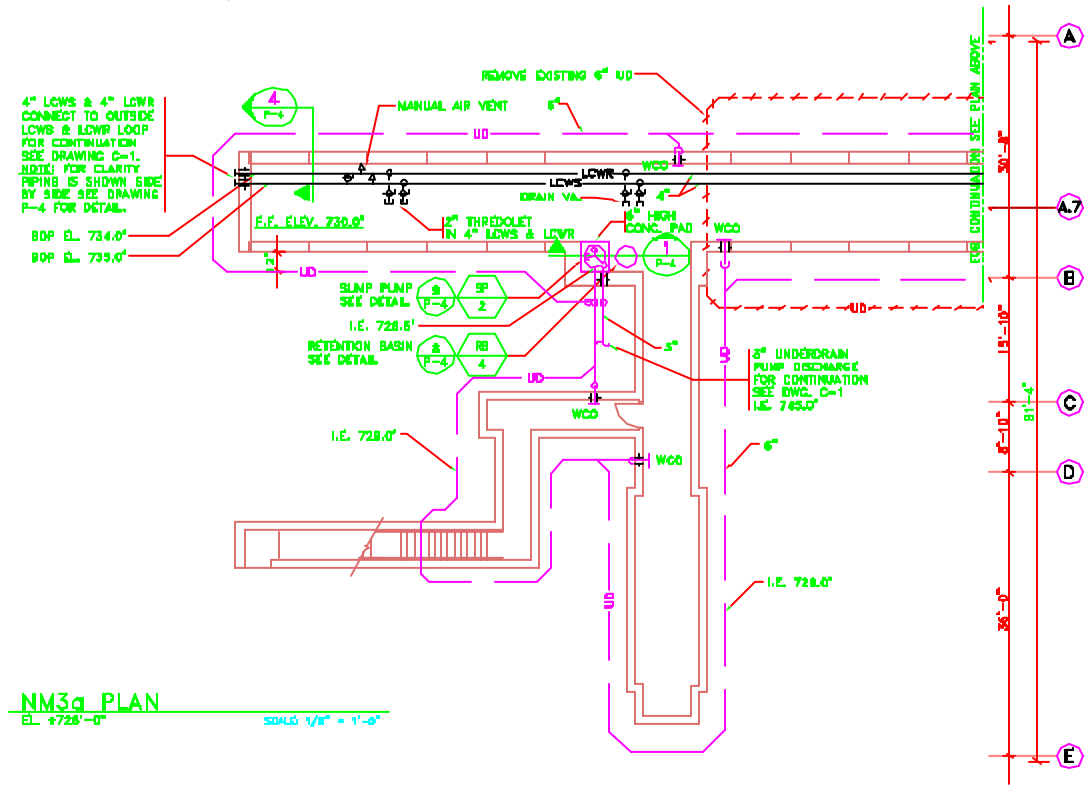

NOTES:
1. UNDERGROUND WATER PIPING SHALL BE INSTALLED A MINIMUM OF 1'-0" BELOW FROST LINE TO TOP OF PIPE. FROST LINE IS 4'-6" BELOW GRADE.

No.	Date	Drawing Issue Description	By

KNIGHT
Knight Architects Engineers Planners, Inc.
540 West Randolph Street
Chicago, IL 60661

	NAME	DATE
DISCIPLINE REVIEW	S. KRSTULOVICH	1/28/94
CONTROLS REVIEW	J. TITUS S. DIXON	1/28/94
ES&H APPROVAL	E. CRUMPLEY	1/28/94
FERMI APPROVAL	W. NESTANDER	1/28/94
DRAWN BY	C. BOCK	1/28/94

PROJECT NORTH

SCALE: 1/8"=1'-0" SCALE FEET

FERMI NATIONAL ACCELERATOR LABORATORY
UNITED STATES DEPARTMENT OF ENERGY

KTeV EXPERIMENTAL AREA
EXPERIMENTAL HALL LEVEL PLAN

DRAWING NO. 8-6-3 P-2 REV.

DOE JOB NO. 7948

DGN:KTEVEXP 01/28/94 10:27:11 User: BKS Elevation: P:\GEND-TOLEIN\KFEP2-02